

Client: **Ameripolish**
 Project: **ASTM C779 Testing**


CTL Project No: **395830**
 CTL Project Mgr.: **Joni Jones**
 Analyst: **J.Pycz**
 Approved: **J. L. Jones**
 Date Analyzed: **February 21, 2014**
 Date Reported: **February 24, 2014**

Contact: **Carl Cabot**
 Submitter: **Carl Cabot**
 Date Received: **February 5, 2014**

**Test Results of ASTM C779 Abrasion Resistance
 Procedure A - Revolving Discs**

Depth of Wear, inches

<u>Sample ID</u>	<u>0 minutes</u>	<u>5 minutes</u>	<u>15 minutes</u>	<u>30 minutes</u>	<u>60 minutes</u>
Control HS	0.000	0.004	0.013	0.024	0.043
Control HS normalized	n/a	0.000	0.008	0.019	0.039
3D-HS	0.000	0.001	0.004	0.009	0.021
3D-HS normalized	n/a	0.000	0.003	0.009	0.020

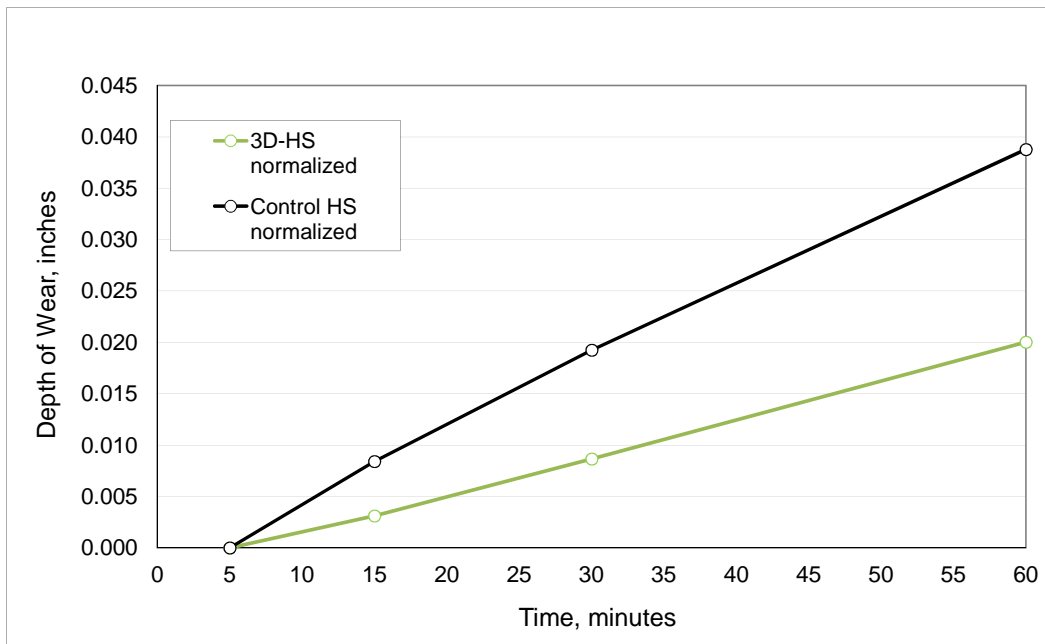

Notes:

1. Concrete sample arrived at CTLGroup on February 5, 2014 in a dry condition.
2. Mixture proportions, cast date and LA abrasion results were not provided.
3. The results specifically represent the submitted sample.
4. This report may not be reproduced except in its entirety.